


DRAIN TO EMBANKMENT SLOPE OR DITCH OUTLET

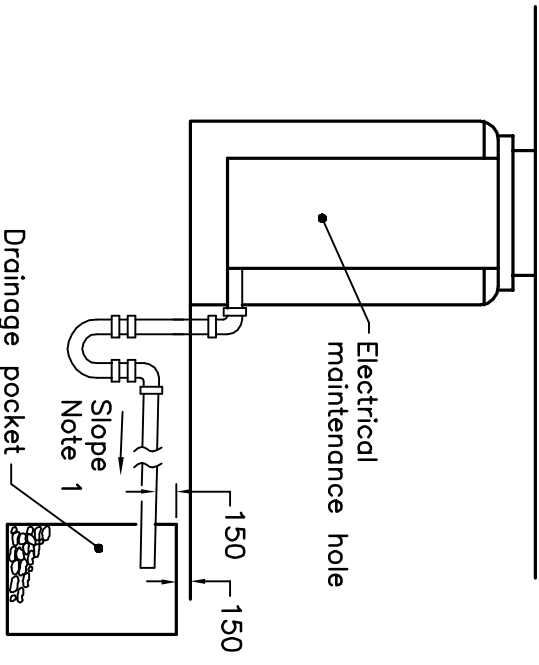

DRAIN TO DRAINAGE POCKET

Varies, Note 2

- NOTES:**
- 1 Drain to slope shall be a minimum of 0.25% (400H:1V) to outlet.
 - 2 Drainage pocket shall be located 1.5m from centreline of maintenance hole in paved or restricted areas and 3.0m from centreline of maintenance hole in grass or unrestricted areas.
 - 3 A 2.5m length of 150mm diameter corrugated steel pipe with galvanized rodent gate shall be installed with drain pipe with 0.3m overlap.
- A All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING		Nov 2013	Rev 1	
ELECTRICAL MAINTENANCE HOLE DRAINS TO DRAINAGE POCKETS, EMBANKMENT OUTLETS, AND DITCHES				
		OPSD 2116.02		